


ADDITIONAL INFORMATION / NOTES:

- (A) A GFI RECEPTACLE IS TO BE PROVIDED IN THE ELEVATOR MACHINE ROOM/SPACE PER NEC-2002 (BY OTHERS)
- (B) MACHINE ROOM DOOR TO BE A MINIMUM OF 30" WIDE AND SWING OUTWARD (BY OTHERS)
- (C) LIGHT SWITCH TO BE INSTALLED ADJACENT TO LOCK SIDE OF THE DOOR AND LIGHT MUST BE PROVIDED INSIDE MACHINE ROOM (BY OTHERS)
- (D) PROVIDE A PHONE LINE TO THE ELEVATOR MACHINE ROOM AND INSTALL IN A 4"X4" BOX WITH COVER. MUST HAVE MIN. 10' - 15' TAIL (BY OTHERS)
- (E) 230 VAC, 2 POLE SINGLE PHASE FUSED DISCONNECT WITH 30 AMP RK-5 FUSES PER NEC-2002 (BY OTHERS)
- (G) PROVIDE 120 V, FUSED DISCONNECT FOR ELEVATOR CAB INTERIOR LIGHT(S), LOCKABLE IN THE OPEN POSITION PER NEC-2002 (BY OTHERS)
- (G) PUMPING UNIT DIMENSIONS: 10"W X 9"D X 60"H
- (H) 6'-6" MINIMUM HEADROOM REQUIRED FOR ELEVATED PLATFORMS OR STANDS

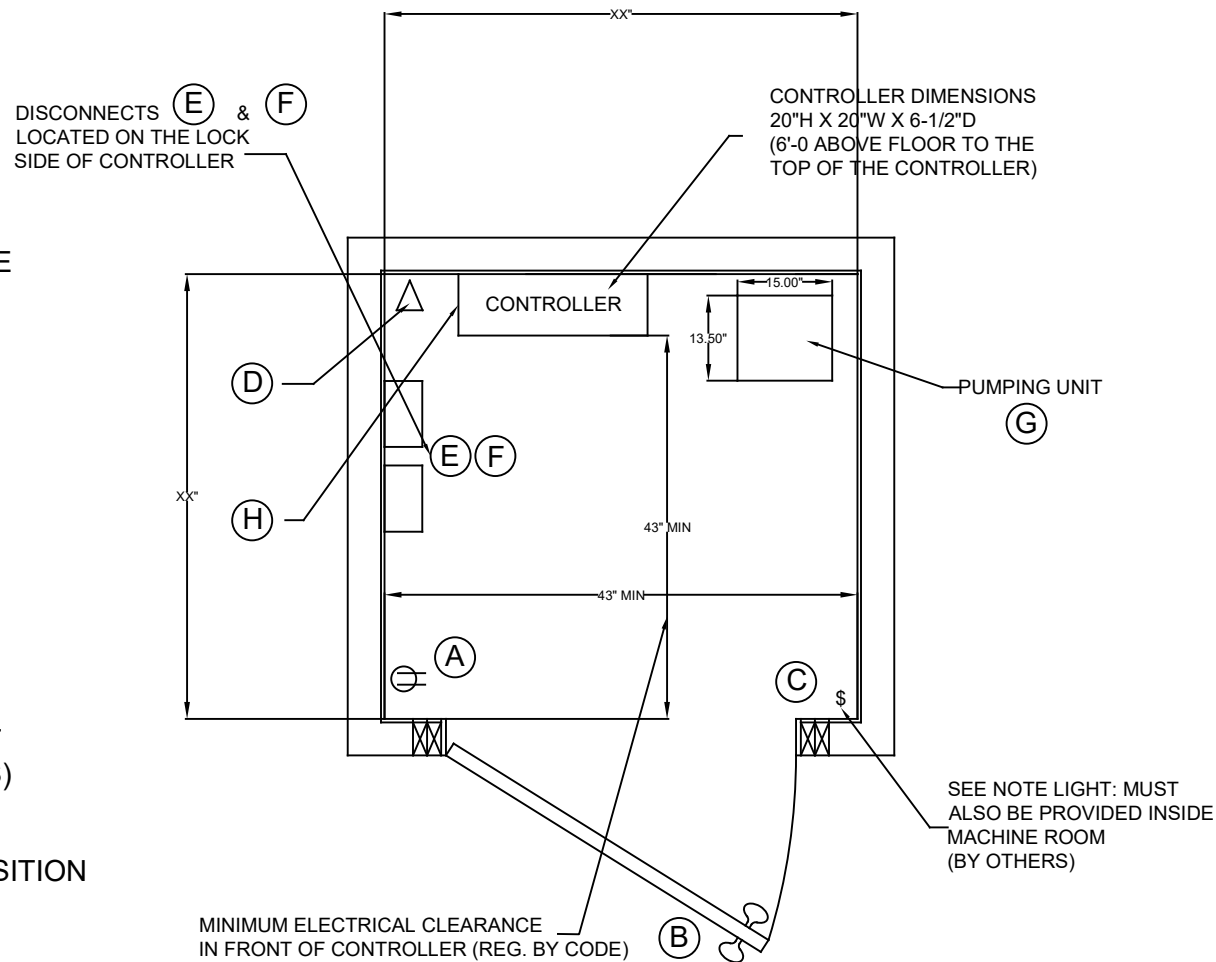

MACHINE ROOM PLAN VIEW
SCALE= NOT TO SCALE

	REV: A	DRAWN BY: MM	CHECKED BY: MM
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF REVELATION MANUFACTURING LLC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT WRITTEN PERMISSION OF REVELATION MANUFACTURING IS STRICTLY PROHIBITED			
			DRAWING: MACHINE ROOM